


I/F P.C.BOARD\*

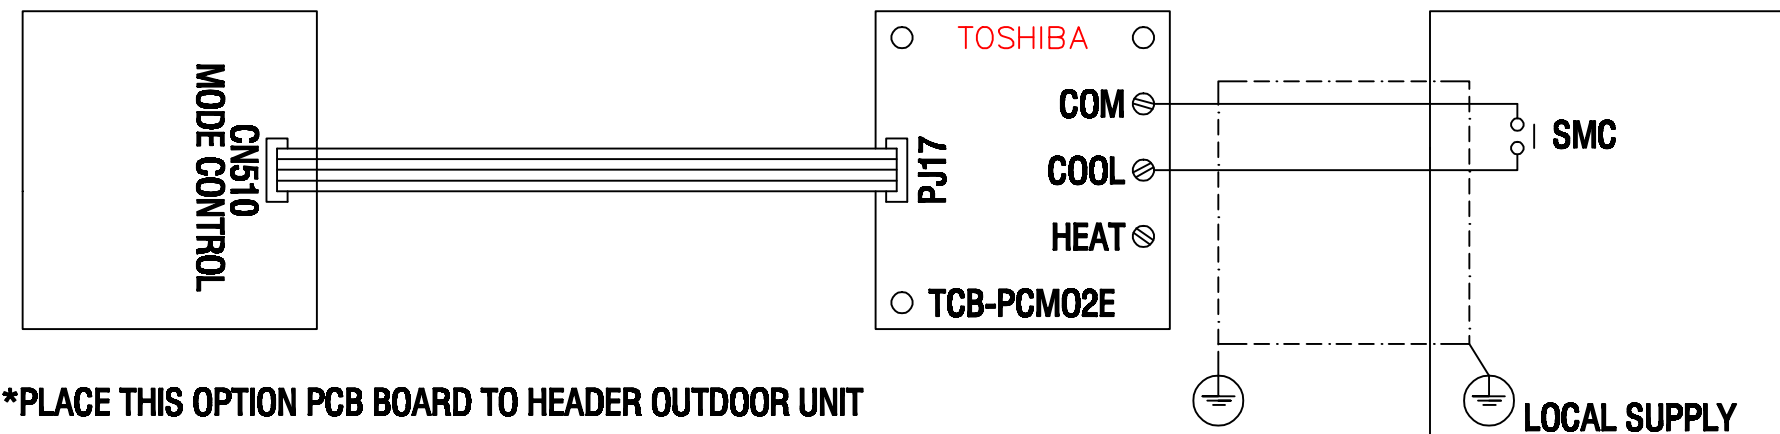

\*PLACE THIS OPTION PCB BOARD TO HEADER OUTDOOR UNIT

**NOTES**

1. IT IS THE RESPONSIBILITY OF THE CONSULTANT OR CONTRACTOR, TO CONFIRM THAT THE CONTROLS SELECTION IS CORRECT PRIOR TO INSTALLATION.
2. DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS SHOULD BE CHECKED ON SITE.
3. THIS DRAWING IS FOR INDICATION ONLY.
4. ALL CONTROLS COMPONENTS SHOULD BE FITTED INSIDE A SUITABLE ENCLOSURE.
5. ALL CABLES MUST BE SIZED ACCORDING TO CURRENT WIRING REGULATIONS.

**LEGEND**

- L Live Wire on Indoor Unit
- N Neutral Wire
- L1 } 3 Phase Power Supply
- L2 } on Outdoor Unit
- L3 }
- A, B Remote Controller Connections
- U1, U2 System Network Connections
- U3, U4 Network Controller Connections
- U5, U6 Outdoor Network Connections

Project

Drawn By

Scale

Date Drawn  
21/05/07

Drawing Prepared For  
COOL DESIGNS LTD

Title

TYPICAL WIRING SCHEMATIC  
OPERATION MODE SELECTION CONTROL  
SHOWING TOUCH SCREEN SET UP & ENERGY MONITORING  
COOLING ONLY ON 2 PIPE VRF

**CDL**  
Cool Designs Ltd

Cool Designs Ltd  
North Hyllon Enterprise Park  
Hegworth Rd  
Sunderland  
SR2 9BL

Tel: 0191 488 884 Fax: 0191 488 888  
email: sales@cooldesigns.co.uk